




BACK TO BACK COUPLERS

INSPECTIONS AND OVERHAULS

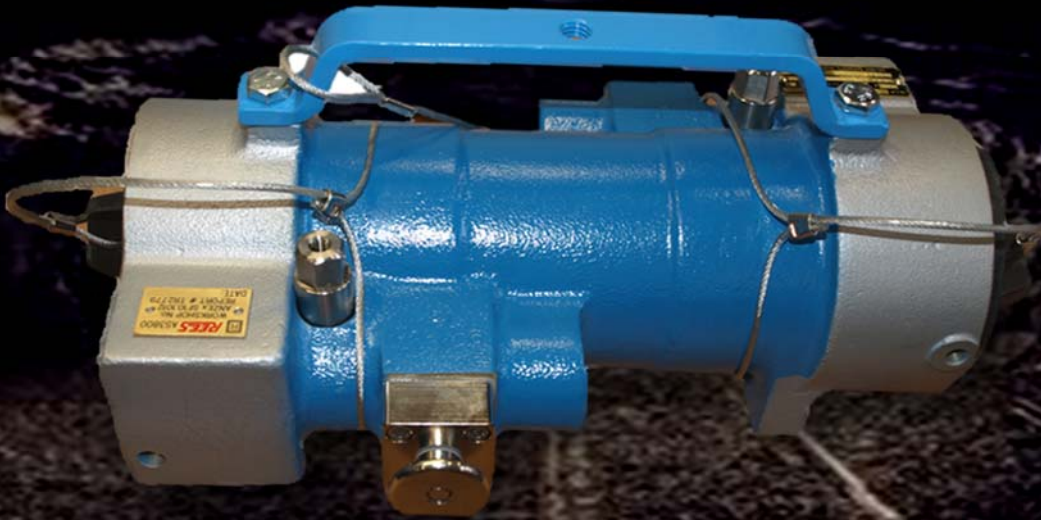

RECOGNIZED SERVICE FACILITY

ANZEx SF 10.1012

Type of Protection Ex d Group I only.

Overhaul of Ex d type back to back couplers, dummy and monitoring plugs and receptacles up to a maximum of 3300 V and a current of 425 A. Also includes end cover mechanical measurement only.

The overhaul is carried out to MP87.2 and AS/NZS 3800:2020 Electrical Equipment for Explosive Atmospheres Repair and Overhaul.

Our process...

Dimensional testing to approved product certification.

The product is then stripped and bead blasted

We then paint the coupler with the approved colour scheme. Handle colour indicates the year overhauled.

The unit is then reassembled and fully tested .

We can also supply new couplers !



RUTHERFORD ELECTRICAL ENGINEERING SERVICES PTY LTD
15 PADDOCK PLACE, RUTHERFORD , NSW 2320

Phone 02 4932 7344

Email purchasing@rutherford.com.au

www.rutherford.com.au

